

Kinetico 2060sOD

System Components

Media Vessel (Qty.) Size (2) 203 x 1,016 mm
 Media Vessel Construction Wrapped Polyethylene
 Empty Bed Volume 29.5 liters
 Media Type Non Solvent Cation Resin
 Media Volume 19.8 liters
 Bed Depth 610 mm
 Free Board 406 mm
 Riser Tube 25 mm ABS
 Distributor Upper 0.36 mm Slots, ABS Basket
 Lower 0.36 mm Slots, ABS Basket
 Under bedding None
 Regeneration Control Non-electric Use Meter
 Regeneration Type Countercurrent
 Meter Type 1.1 – 94.6 Lpm Polypropylene Turbine

Inlet Water Quality

Pressure Range 15 – 125 psi Dynamic Pressure
 Temperature Range 35 – 120° F
 pH Range 5 – 10 SU
 Free Chlorine Cl₂ (Max.) 2.0 mg/L
 Hardness as CaCO₃ (Max.) 66 gpg

Operating Specs

Flow Range (15 / 30 psig) 78 – 114 Lpm
 Flow Configuration Overdrive
 Dimensions (Width x Depth x Height) 432 x 203 x 1,168 mm
 Weight (Operating / Shipping) 91 / 64 kg

Connections

Inlet / Outlet Connections Custom Adapter and E-clip
 Drain Connection 0.5" Tube
 Brine Line Connection 0.375" Tube
 Power None

System Part Numbers

Kinetico 2060s OD, 18 x 35 brine drum 11201
 Kinetico 2060s OD, no brine drum 11202
 Kinetico 2060s OD, no resin, no brine drum 11789

Brine Tank Options

Tank Description	12 x 16 x 20	12 x 40	K Spray	18 x 35
Brine Tank Part Number	7202	1479B	9763A	7938
Tank Height	51 cm	102 cm	89 cm	89 cm
Tank Footprint	30 x 41 cm	30 cm DIA	46 cm DIA	46 cm DIA
Material	HDPE	HDPE	HDPE	HDPE
Salt Capacity	23 kg	45 kg	91 kg	114 kg



Regeneration Specifications

Regeneration Volume 132 liters
 Regeneration Time 45 minutes
 Backwash Flow Control 7.6 Lpm
 Brine Refill Flow Control 1.5 Lpm

Setting	Capacity	Efficiency	Dosing	Meter Disc
**1.2 kg	808 grams	660 grams/kg	0.06 kg/L	
**1.8 kg	1,023 grams	564 grams/kg	0.09 kg/L	
2.0 kg	1,076 grams	539 grams/kg	0.10 kg/L	

Liters/Regeneration:

** Settings certified by NSF and or WQA

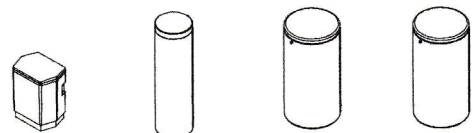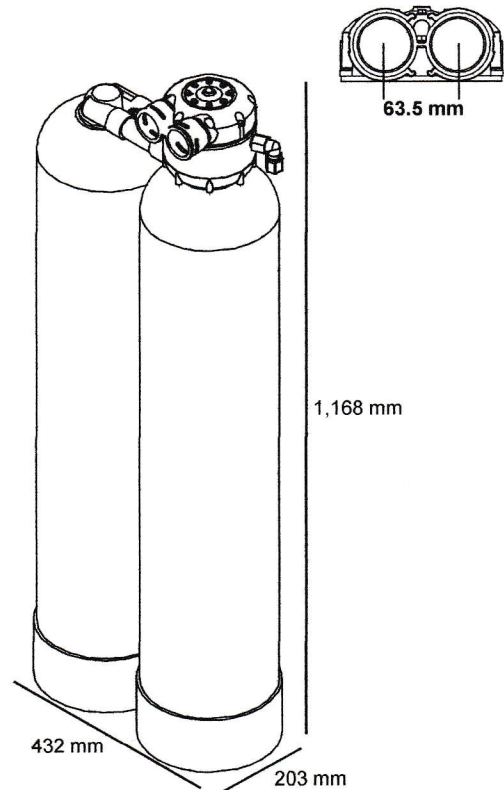

Disc Selection

(Compensated Hardness*)

	1	2	3	4	5	6	7	8
51	103	154	188	239	291	325	376	
68	137	188	257	291	359	428	479	
68	137	205	274	325	393	445	513	
12,004	6,002	4,001	3,001	2,401	2,001	1,714	1,500	

*Compensated hardness in mg/L = Hardness + (51 x Fe in mg/L)

revision date: August 24, 2010



Operating Profile

Softener shall remove hardness to less than 8 mg/L when operated in accordance with the operating instructions. The system shall include two tanks. This duplex configuration shall operate with both tanks on-line during service. During regeneration cycles, one tank shall provide water to service and to the regenerating tank. A water meter shall initiate system regeneration. The water meter shall measure the processed volume and be adjustable. Service flow shall be downflow and regeneration flow shall be upflow.

Regeneration Control Valve

The regeneration control valve shall be top mounted (top of media tank), and manufactured from non-corrosive materials. Control valve shall not weigh more than four pounds. Control valve shall provide service and regeneration control for two media tanks. Inlet and outlet ports shall accept a quick connect, double O-ring sealed adapter. Interconnection between tanks shall be made through the regeneration valve with a quick connect adapter. Control valve shall operate using a minimum inlet pressure of 1 bar. Pressure shall be used to drive all valve functions. No electric hook-up shall be required. Control valve shall incorporate four operational cycles including; service, brine draw, slow rinse, and a combined fast rinse and brine refill. Service cycle shall operate in a downflow direction. The brine cycle shall flow upflow, opposite the service flow, providing a countercurrent regeneration. Control valve shall contain a fixed orifice eductor nozzle and self-adjusting backwash flow control. The control valve will prevent the by-pass of hard water to service during the regeneration cycle.

Media Tanks

The tanks shall be designed for a maximum working pressure of 8.6 bar and hydrostatically tested at 20.7 bar. Tanks shall be made of engineered plastic with a 2.5 in. threaded top opening. Each tank shall be NSF approved. Upper distribution system shall be of a slot design. Lower distribution system shall be of a flat plate design. Distributors will provide even flow of regeneration water and the collection of processed water.

Conditioning Media

Each softener shall include non-solvent cation resin having a minimum exchange capacity of 68.6 grams of CaCO₃ per liter of resin when regenerated with 0.24 kg of salt per liter of resin. The media shall be solid, of a proper particle size and shall contain no plates, shells, agglomerates or other shapes, which might interfere with the normal function of the water softener.

Brine System

A combination salt storage and brine production tank shall be manufactured of corrosion resistant, plastic. The brine tank shall have a chamber to house the brine valve assembly. The brine float assembly shall allow for adjustable salt settings and shall provide for a shutoff to the brine refill. The brine tank shall include a safety overflow connection to be plumbed to a suitable drain.

